

MPRN Creation Scenarios

xserve



respect > commitment > teamwork

MPRN Creation Scenarios


At the Shipperless and Unregistered Workgroup Meeting held in April 2012, an agreement was made on which of a number of scenarios would require a new MPRN to be created. The following slides illustrate the scenarios.

xserve



respect > commitment > teamwork

Scenario A

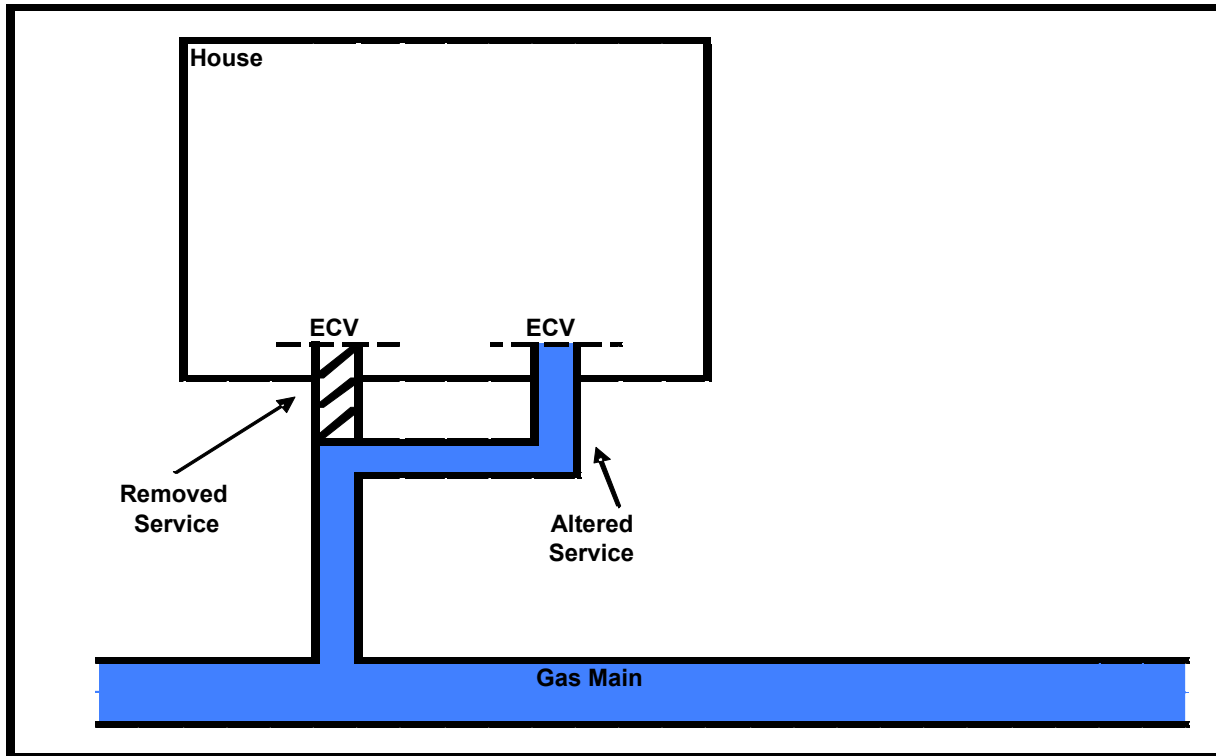

**Service laid at same point on the main
(Alteration of service, Service replacement & Capacity increase)**


- Existing MPRN should be used.
- No new MPRN required.

xserve



respect > commitment > teamwork

Scenario B

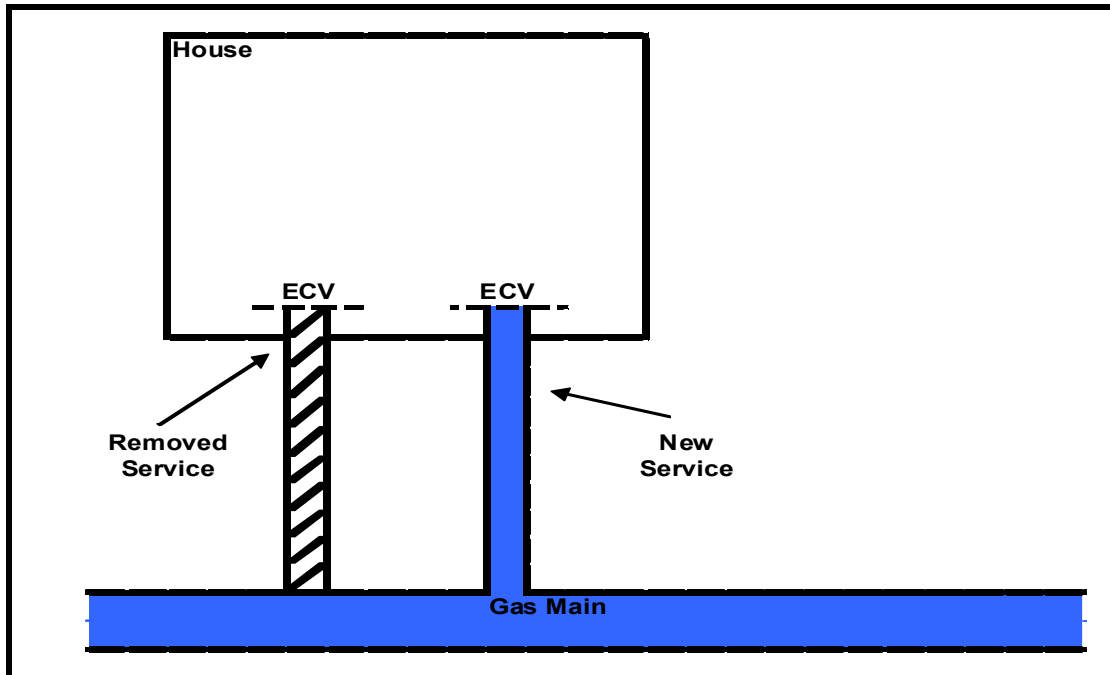

Old service disconnected and new service fitted at a different location in the gas main


- Existing MPRN should be used and old service isolated.
- No new MPRN required.

xserve



respect > commitment > teamwork

Scenario C

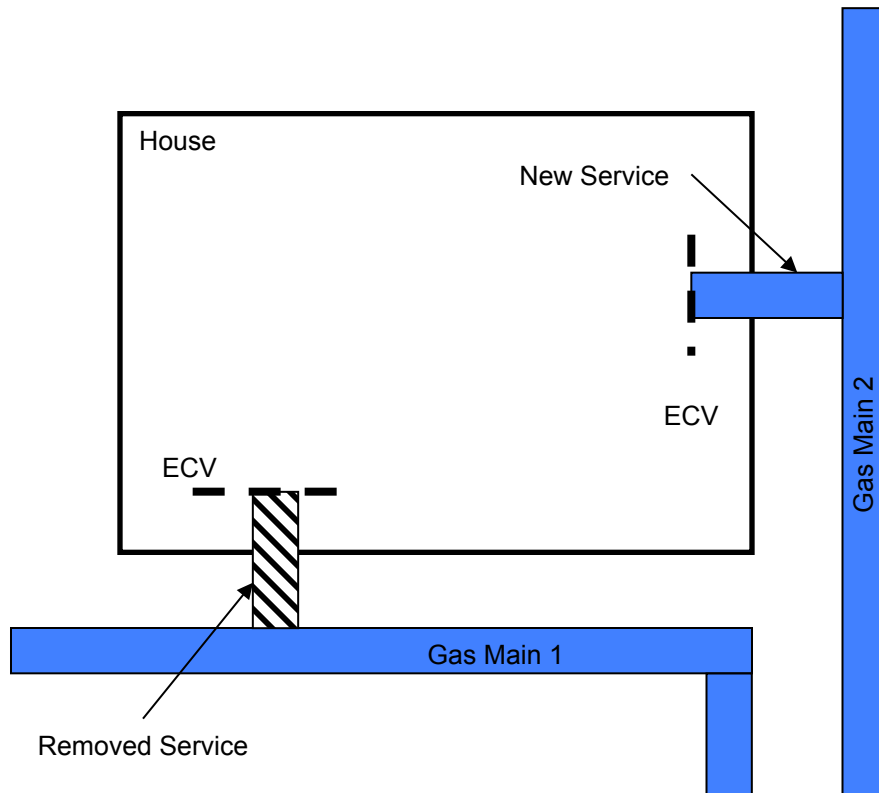

Old service disconnected and new service fitted at different main.


- Existing MPRN should be used and old service isolated.
- No new MPRN required.

xserve



respect > commitment > teamwork

Scenario D

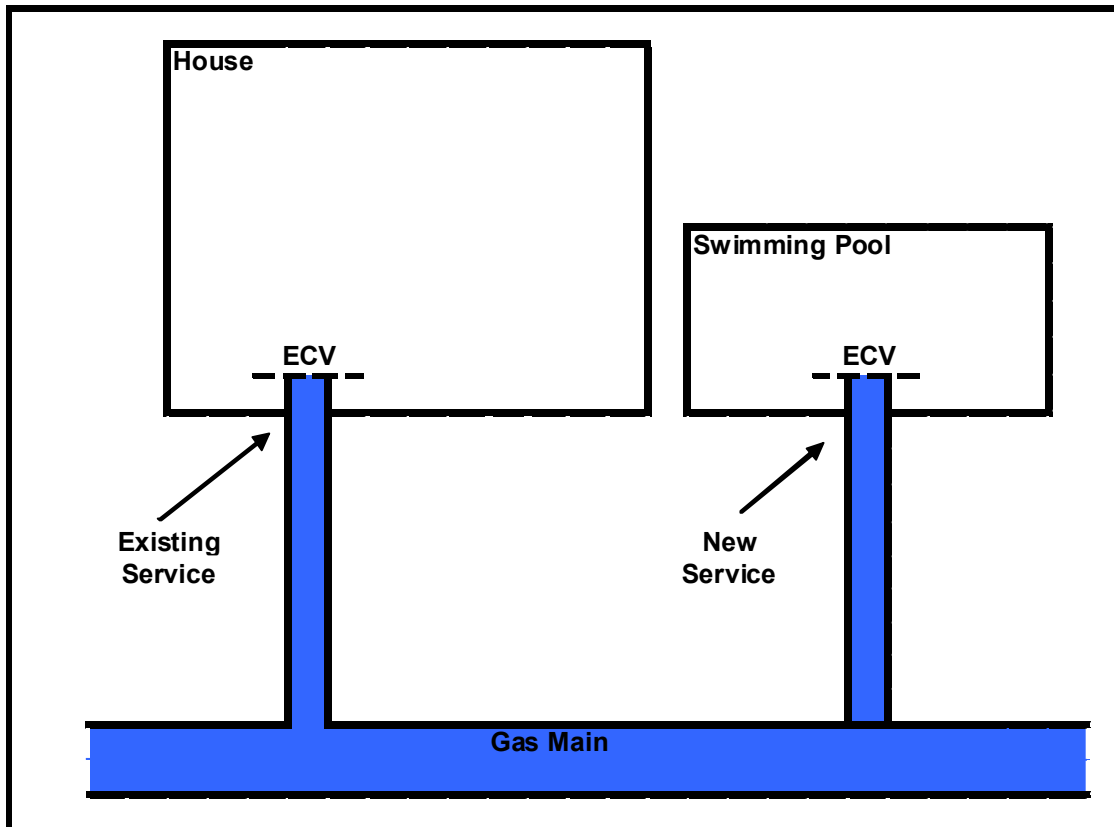


Additional service fitted at different points in same gas main.

- **New MPRN should be created.**

xserve




respect > commitment > teamwork

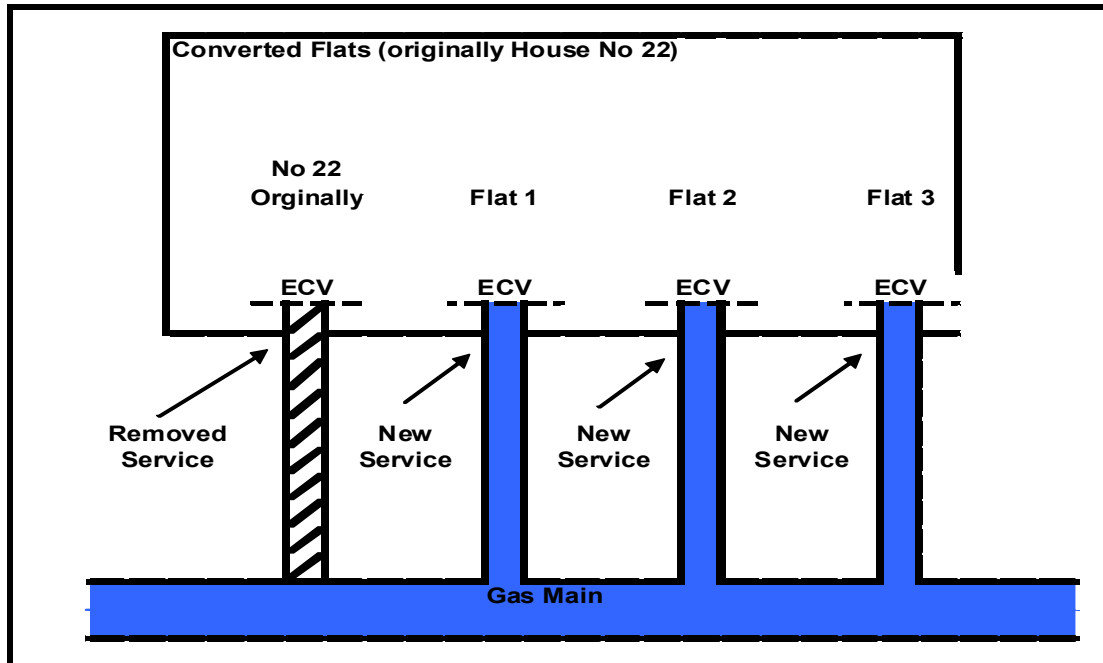

House converted to flats old service removed and additional services fitted at different points in the same gas main

- 3 New MPRNs should be created.
- Old service should be isolated.

Scenario F

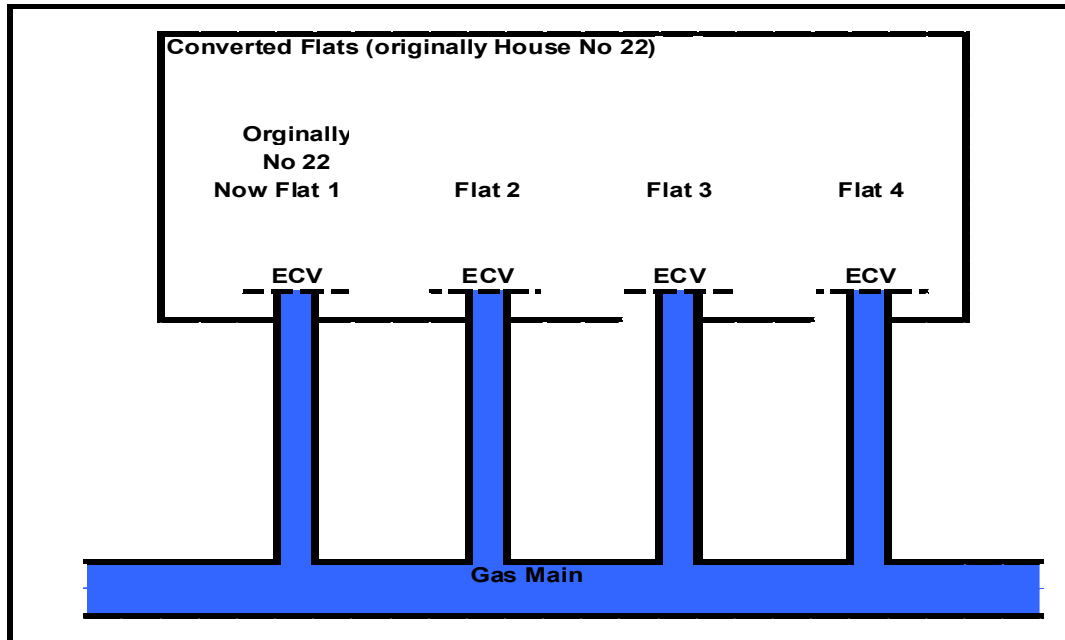


House converted to flats and existing service changed to flat 1 and additional services fitted at different points in the same gas main.

- 3 new MPRNs should be created.
- Address amendment would be required for original MPRN to reflect 'flat 1'.

xserve



respect > commitment > teamwork

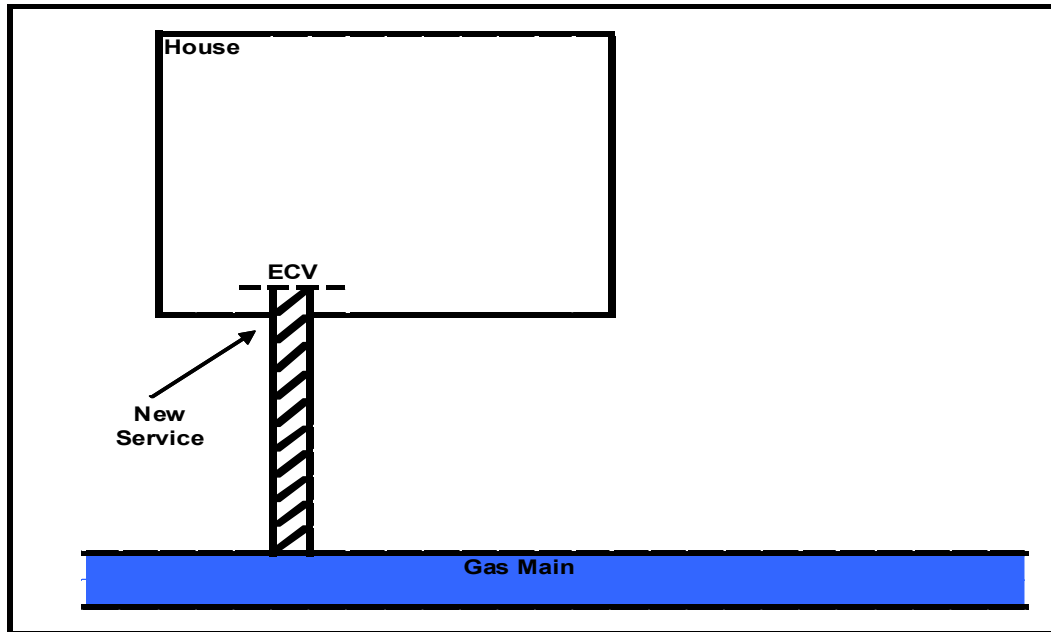

New service laid at any point on the main (New Development – Could be a plot address)

- New MPRN should be created.