


Statement of Transportation Charges

Effective from 1st April 2024

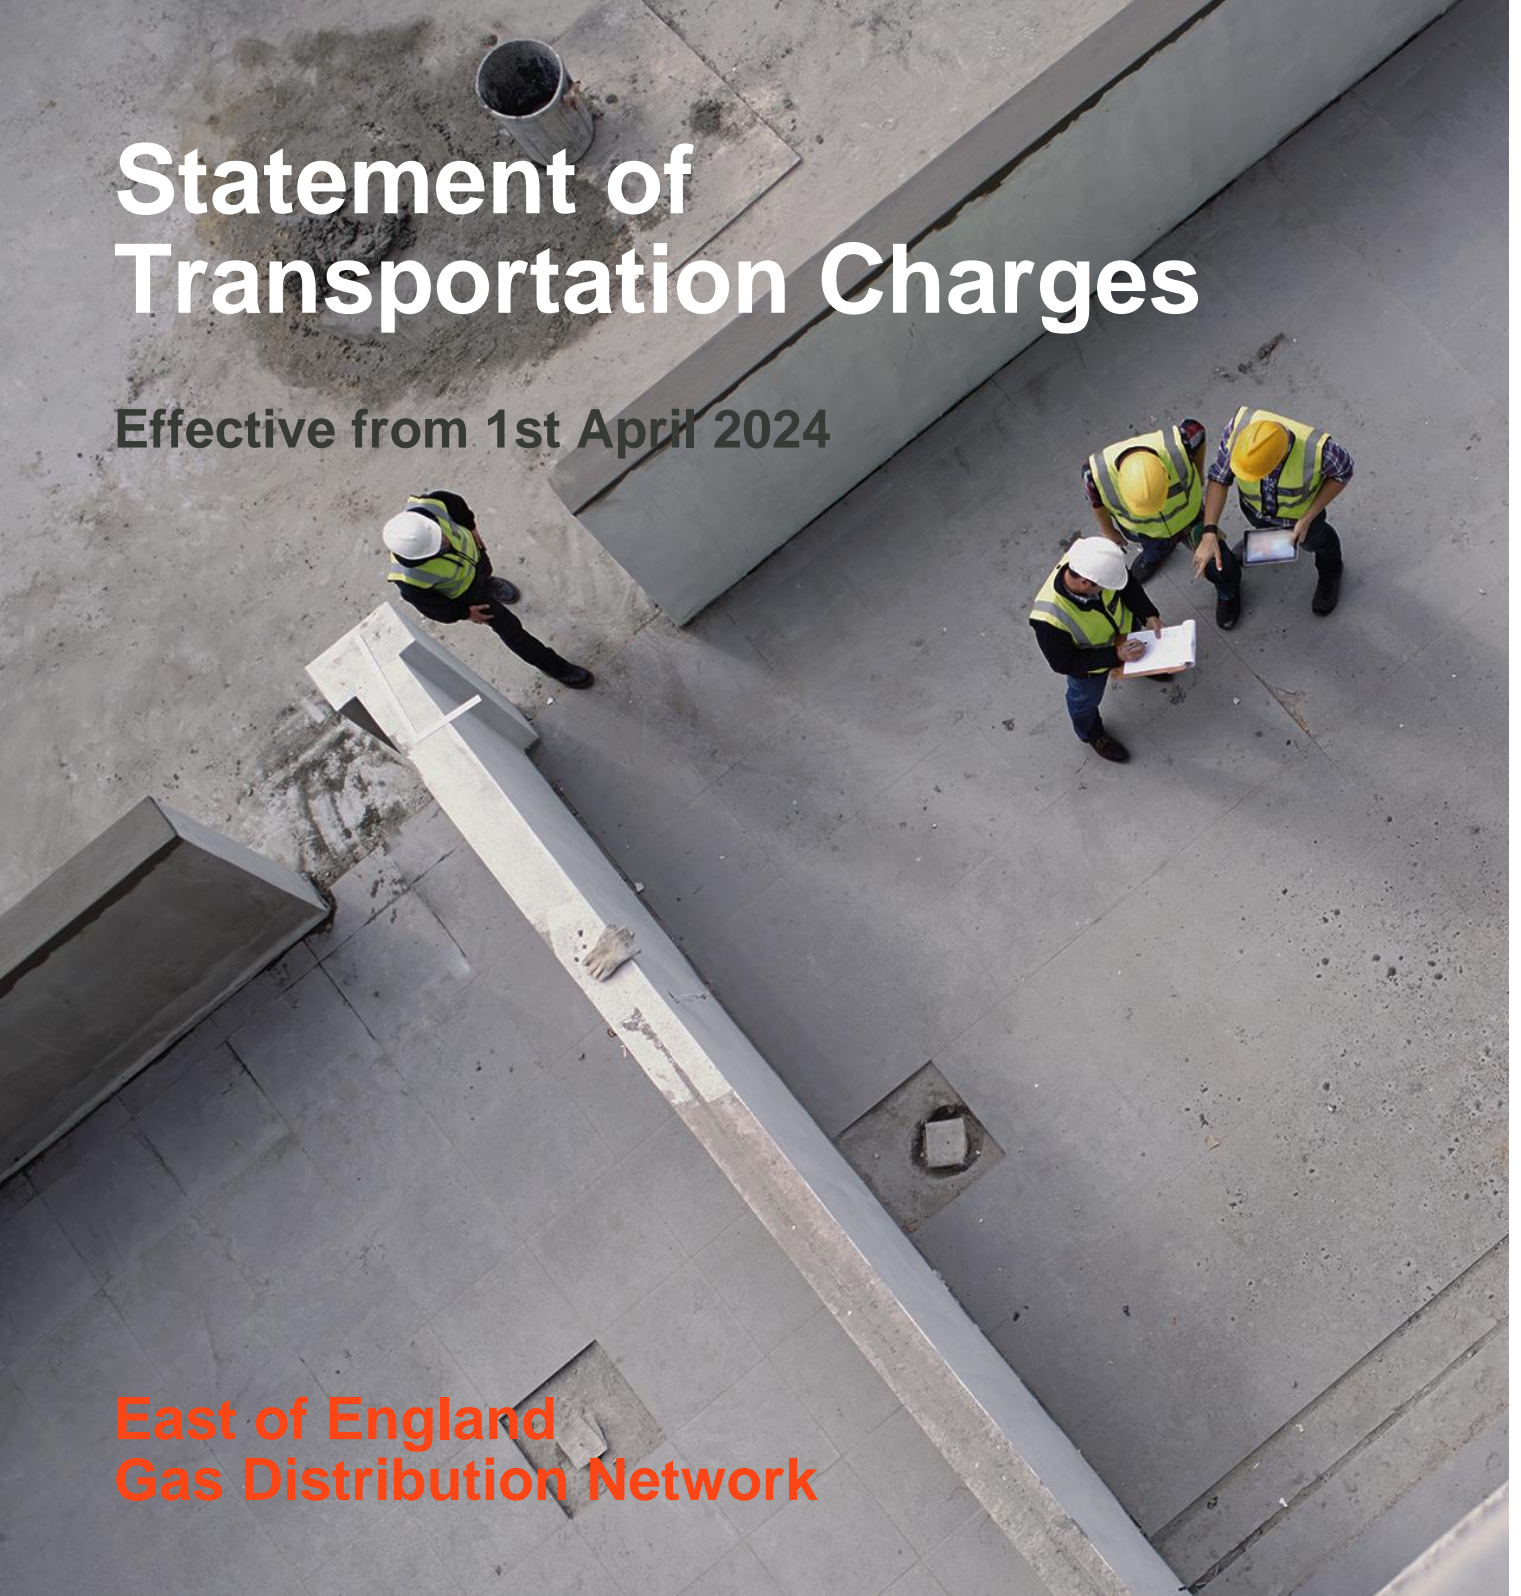

**East of England
Gas Distribution Network**

Contents

Introduction	3
LDZ System Charges.....	5
LDZ Customer Charges	6
LDZ Exit Capacity NTS (ECN) Charges.....	7
Supplier of Last Resort Charges	8
DN System Entry Commodity Charge.....	9
Charge Types and Invoice Mapping	11
Examples	12
Contact Details.....	15
Appendix A: Estimation of Peak Daily Load for Non-Daily Metered Supply Points	16
Appendix B: Application of Transportation Charging Methodology	18

Introduction

This publication sets out the transportation charges that apply from 1st April 2024 for the use of the East of England Gas Distribution Network, as required by Standard Special Condition A4 of the Gas Transporter Licence. This document does not override or vary any of the statutory, Licence or Uniform Network Code obligations.

Uniform Network Code

The Uniform Network Code (UNC) is supported by an integrated set of computer systems called UK Link. The charges and formulae in this publication will be used in the calculation of charges within UK Link, which are definitive for billing purposes.

For further information and details on the methodologies underlying the LDZ transportation charges please refer to the documents referenced within the Appendices and the Uniform Network Code (UNC). These methodologies are set out in the UNC, within the Transportation Principal Document Section Y Part B, and are subject to alteration under the governance of UNC Modification Rules.

All UNC documents and Modifications can be found on the Joint Office of Gas Transporters website: www.gasgovernance.co.uk

The Distribution Transportation Price Control Formula

Distribution networks set prices with the aim of recovering the level of allowed revenue permitted by the gas and electricity market regulator Ofgem, calculated in accordance with our Gas Transporter Licence. Should more or less than the maximum permitted revenue be collected in any formula year, then a compensating adjustment is made in the subsequent year.

Units

- Commodity charges are expressed and billed in pence per kilowatt hour (kWh)
- Capacity charges are expressed and billed in pence per peak day kilowatt hour per day
- Fixed charges are expressed and billed in pence per day

Invoicing

Correlia (formerly Xoserve) is the third party responsible for hosting and supporting the UK Link system and act as the billing agent for the gas networks, including Cadent. They produce and issue the invoices that are derived from the transportation charges shown within this publication. Each charge levied has an associated charge code and invoice type which has been included within this publication to clarify the link between charging and invoicing and to aid better understanding of bills.

For more information on invoicing, please contact Correlia (formerly Xoserve) directly at capcom@xoserve.com

Gas Distribution Network, Forecast Allowed Revenue for the Regulatory Year 2024/25

Following publication of Final Charges on 31st January 2024 unit rates have not changed. For further details please refer to Joint Office website.

Maximum Allowed Revenue for the East of England Network for the forthcoming regulatory formula year 2024/25 is £719.6m. This is a decrease of 11.4% against 2023/24 primarily due to lower Supplier of Last Resort (SoLR) claims which form a part of our Allowed Revenues. Underlying revenues have reduced due to lower SoLR claims, a reduction in shrinkage costs due to lower gas prices, lower exit capacity costs due to lower unit rates and volumes and tax allowances. This is partially offset by higher inflation, VCMA costs and allowed returns as detailed in the table below. Further details are provided in our Pricing notifications published 31st January 2024.

Should more or less than the maximum permitted revenue be earned in any formula year, then under RIIO-GD2 methodology this is trued up/ down to the following years allowed revenue position.

EAST OF ENGLAND	LDZ	ECN	SOLR	TOTAL
FY23/24 CHARGES	716.0	54.8	41.1	811.9
SOLR ASSUMPTION PENDING OFGEM CONFIRMATION	-	-	(39.7)	(39.7)
INFLATION OF BASE ALLOWANCES	21.9	-	-	21.9
CHANGE IN EXIT CAPACITY INCLUDING TRUE UP FROM PRIOR YEARS		(14.0)		(14.0)
CHANGE IN GAS PRICES INCLUDING TRUE UP FROM PRIOR YEARS	(52.2)			(52.2)
INCREASE IN OTHER PASS THROUGH COSTS	(7.2)			(7.2)
TAX ALLOWANCE CHANGE INCLUDING TAX TRIGGER EVENT	(29.0)			(29.0)
INCLUSION OF VCMA AS "OTHER REVENUE ALLOWANCE"	9.2	-	-	9.2
INCREASE IN ALLOWED RETURNS	8.0			8.0
CHANGE IN TOTEX ALLOWANCES	2.6			2.6
OVER / (UNDER) RECOVERY ("K")	(1.5)	(0.6)	(0.5)	(2.6)
OTHER INDIVIDUALLY SMALLER ITEMS	9.2	1.5	(0.0)	10.7
FY24/25 INDICATIVE CHARGES	677.1	41.7	0.8	719.6
CHANGE	(38.9)	(13.2)	(40.3)	(92.3)
% CHANGE	(5.4%)	(24.0%)	(98.0%)	(11.4%)

Theft of Gas

The licensing regime places incentives on Transporters, Shippers and Suppliers to take action in respect of suspected theft of gas. Certain costs associated with individual cases of theft are recovered through transportation charges with the Transporter remaining cash neutral in the process.

LDZ System Charges

Standard LDZ System Charge

The standard LDZ system charges comprise of capacity and commodity charges, with the same rates and functions applicable for both Directly Connected Supply Points and Connected System Exit Points (CSEPs).

Where the LDZ charges are based on functions, these functions use Supply Point Offtake Quantity (SOQ) in the determination of the charges. At daily metered (DM) supply points, the SOQ is the registered supply point capacity. For non-daily metered (NDM) supply points, the SOQ is calculated using the supply point End User Category (EUC) and the appropriate load factor.

Directly Connected Supply Points and CSEPs

Charge codes, unit rates and charging functions used to calculate charges to Directly Connected Supply Points and CSEPs are set out in the tables below.

Table 1: Charge Codes for Directly Connected Supply Points and CSEPs

Directly Connected		CSEPs	
Invoice Type	Charge Code	Invoice Type	Charge Code
Capacity (CAZ)	ZCA	Capacity (CAZ)	891
Commodity (COM)	ZCO	Commodity (COM)	893

Table 2: LDZ System Charges for Directly Connected Supply Points & CSEPs

Charge Band (kWh per annum)	LDZ Capacity (pence per peak day kWh per day)	LDZ Commodity (pence per kWh)
UP TO 73,200 KWH PER ANNUM	0.2226	0.0385
73,200 KWH - 732,000 KWH PER ANNUM	0.1779	0.0305
732,000 KWH PER ANNUM AND ABOVE	$1.1369 \times \text{SOQ}^{-0.2155}$	$0.2444 \times \text{SOQ}^{-0.2376}$
SUBJECT TO A MINIMUM RATE OF	0.0217	0.0034

MINIMUM RATE APPLIES AT SOQ OF (KWH)	95,064,068	65,172,871
--------------------------------------	------------	------------

CSEP Charging

In the calculation of LDZ charges payable for CSEPs, the unit commodity and capacity charges are based on the supply point capacity equal to the CSEP peak day load for the completed development irrespective of the actual stage of development. The SOQ used is therefore the estimated SOQ for the completed development as provided in the appropriate Network Exit Agreement (NExA). For any particular CSEP, each Shipper will pay identical LDZ unit charges

regardless of the proportion of gas shipped. Reference needs to be made to the relevant NExA or CSEP ancillary agreement to determine the completed supply point capacity.

Optional LDZ Charge

The optional LDZ tariff is available, as a single charge, as an alternative to the standard LDZ system charges. This tariff may be attractive to large loads located close to the NTS. The rationale for the optional tariff is that, for large Network loads located close to the NTS or for potential new Network loads in a similar situation, the standard LDZ tariff can appear to give perverse economic incentives for the construction of new pipelines when Network connections are already available. This could result in an inefficient outcome for all system users.

Table 3: Optional LDZ Charge Function

Charge Code	Pence per peak day kWh per day
881	$902 \times [(SOQ)^{-0.834}] \times D + 772 \times (SOQ)^{-0.717}$

Please Note:

SOQ = the Registered Supply Point Capacity, or other appropriate measure, in kWh per day.

D = the direct distance, in km, from the site boundary to the nearest point on the NTS.

^ Means “to the power of ...”

LDZ Customer Charges

LDZ Customer charges apply only to Directly Connected Supply Points.

For supply points with an AQ of less than 73,200 kWh per annum, the customer charge is a capacity-based charge.

For supply points with an AQ between 73,200 and 731,999 kWh per annum, the customer charge is made up of a fixed element that depends on the frequency of meter reading, plus a capacity charge based on the registered supply point capacity (SOQ).

For supply points with an AQ of 732,000 kWh per annum or more, the customer charge is based on a function related to the registered supply point capacity (SOQ). The charge codes, unit rates and charging functions used to calculate customer charges to Directly Connected Supply Points are set out in the table below.

Table 4: LDZ Customer Capacity Charge Codes, Unit Rates and Charging Functions

Charge Code	CCA
Charge Band (kWh per annum)	Unit Rate (pence per peak day kWh per day)
UP TO 73,200 KWH PER ANNUM	0.1280
73,200 KWH - 732,000 KWH PER ANNUM	0.0042
732,000 KWH PER ANNUM AND ABOVE	$0.0908 \times SOQ^{-0.21}$

Table 5: LDZ Customer Fixed Charge Codes and Unit Rates

Charge Code	CFI
Fixed charge	Unit Rate (pence per day)
Non-monthly read supply points	37.5824
Monthly read supply points	40.0169

LDZ Exit Capacity NTS (ECN) Charges

The NTS Exit Capacity prices published by National Gas have been factored into the ECN Price change. Distribution Networks (DNs) set ECN unit rates to recover their ECN specific allowed revenue, incorporating the latest demand volumes. The ECN allowed revenue is set during the recent Annual Iteration Process and is made up of:

- ECN base allowance which is a forecast of NTS exit capacity costs, using latest published NTS ECN rates and network capacity bookings;
- ECN cost true ups i.e. the difference between actual cost the costs previously charged for in prior years

When setting ECN rates, DN's seek to recover their allowed revenue as calculated above, rather than solely costs for the year.

To calculate the unit rates for each exit zone within a network the level of NTS cost per exit zone is used to apportion the total ECN allowed revenue across each exit zone. Once the revenue that needs to be recovered from each exit zone is determined, the latest demand snapshot of SOQs is used to calculate a unit rate per exit zone.

Shipper demand can differ to DN capacity bookings for a number of reasons, including the timing of DN bookings vs. the demand snapshot and any user commitment in place that networks have to consider.

National Gas Transmission will invoice gas Distribution Networks (DN's) for booked NTS Exit Capacity and DN's will invoice Shippers. The ECN charging methodology is covered in Section Y Part B (9) of the UNC. ECN charges are designed to recover the annual amount of exit capacity cost as defined in the Gas Transporter Licence (inclusive of timing adjustments between allowed and actual costs) and adjustments for any under or over recovery of ECN revenue from the prior year.

The charge codes and unit rates used to calculate ECN charges for Directly Connected Supply Points and CSEPs are set out in the table below. As per the LDZ System Charge, the same unit rates apply for both Directly Connected Supply Points and CSEPs.

Table 6: LDZ Exit Capacity NTS (ECN) Charge Codes and Unit Rates

Invoice Type	Charge Code
Directly Connected	ECN
CSEPS	C04

Exit Zone	Unit Rate (pence per peak day kWh per day)
EA1	0.0162
EA2	0.0162
EA3	0.0162
EA4	0.0162
EM1	0.0162
EM2	0.0162
EM3	0.0162
EM4	0.0162

Supplier of Last Resort Charges

UNC Modification 0797 'Last Resort Supply Payments Volumetric Charges' was approved by OFGEM for implementation. The total costs associated with allowed SoLR claims has been agreed by Ofgem. The charge type and information in the table below for SoLR cost recovery is only attributable to Domestic users as agreed with Ofgem

Table 7: Supplier of Last Resort Unit Rates

CHARGE CODE: LRI / LRD	PENCE / PEAK DAY Kwh
LRSP DOMESTIC CHARGE (LRD)	0.0004
LRSP INDUSTRIAL CHARGE (LRI)	0.0000

DN System Entry Commodity Charge

The DN System Entry Commodity Charge came into effect on the 1st April 2013 and reflects the cost of receiving gas directly into the distribution network through a LDZ System Entry Point rather than through the NTS.

The rate associated with the LDZ System Entry Commodity charge is calculated on a site by site basis and may be positive resulting in a charge, or negative resulting in a credit.

The level of charge / credit will vary according to the amount of gas entering the network system, the pressure tier at which the gas enters the system and the operational costs associated with the entry point.

The charge / credit is made up of the following three elements and is an adjustment to the full transportation charge:

- **Operational Costs:** the Shipper will be charged for operational costs incurred by the Distribution Network in maintaining the entry point connection to the system
- **Exit Capacity Credit:** the Shipper will receive a credit in respect of exit capacity charges as the gas has not entered the Distribution Network via the National Transmission System in the traditional way.
- **System Credit:** the Shipper will receive a level of credit depending on the pressure tier at which the entry point connects. This is to reflect lower overall system usage than gas that enters the network via the National Transmission System. Sites connected at the Local Transmission Network (LTS) receive no credit.

The table on the following page provides details on LDZ System Entry unit rates for all sites with accepted connection offers that are expected to be in operation during 2024/25. As and when connection offers are accepted for additional sites expected to come into operation during the year, unit prices will be notified under the [‘Notice of Charges’](#) section of the Joint Office of Gas Transporters website.

Table 8: LDZ System Entry Unit Rates

Charge Code	Gemini ID	LEC	
		Charge / Credit	Unit Rate (pence per kWh)
DN Entry Point (Site Name)			
Attleborough	ATLEOS	CREDIT	(0.0781)
Bay Farm	BAFMOS	CREDIT	(0.0005)
Beccles, Sotterley	SOTLOS	CREDIT	(0.0898)
Biodynamic	BIODOS	CREDIT	(0.1091)
Bonby	BONBOS	CREDIT	(0.0071)
Chear Fen Farms, Chittering	CHITOS	CREDIT	(0.1135)
Chittering 2	CHI2OS	CREDIT	(0.1102)

Charge Code		LEC	
DN Entry Point (Site Name)	Gemini ID	Charge / Credit	Unit Rate (pence per kWh)
Deephams STW Biomethane	DEEPOS	CREDIT	(0.1098)
Euston	LANKOS	CREDIT	(0.0076)
Fairfields Farm, Wormingford	FAIROS	CHARGE	0.0011
Glebe Farm		CREDIT	(0.0054)
Hemswell Cliff	HMWLOS	CREDIT	(0.0771)
Holkham, Norfolk	HOLKOS	CREDIT	(0.0039)
Ilkeston		CREDIT	(0.1019)
Lindholme, Doncaster	LINDOS	CREDIT	(0.0829)
Manor Farm, Alderton	MANROS	CREDIT	(0.1078)
Mepal	MEPAOS	CREDIT	(0.1091)
Metheringham MP / IP	METHOS	CREDIT	(0.1043)
Methwold	METWOS	CREDIT	(0.0018)
North Moor Farm, Crowle	MOOROS	CREDIT	(0.0646)
Raynham Farm	RAYNOS	CREDIT	(0.0005)
Redbourne Road, Hibaldstow	HLBDOS	CREDIT	(0.1112)
Scampton	SCAMOS	CREDIT	(0.0829)
Stoke Bardolph	STOKOS	CREDIT	(0.0961)
Stoke Bardolph 2	STOBOS	CREDIT	(0.0864)
The Oaks		CREDIT	(0.0018)
Thorpe Arnold		CREDIT	(0.0090)
Welbeck Colliery, Meden Vale	WELLOS	CREDIT	(0.1062)
Westry	WSTYOS	CREDIT	(0.0060)
Singleton Birch		CREDIT	(0.0775)
Stanton Energy Biomethane	STANOS	CREDIT	(0.1019)

Charge Types and Invoice Mapping

The following list presents the core invoice types and charge codes reflected in this document, which are billed by Correla (formerly Xoserve) on our behalf. A full list of current invoice types and charge codes is available through the Correla (formerly Xoserve) Shared Area.

Table 9: Invoice Types and Charge Codes

	Invoice Type	Charge Codes
LDZ Capacity		
Supply Point LDZ Capacity	CAZ	ZCA
CSEP LDZ Capacity	CAZ	891
Unique Sites LDZ Capacity Charge	CAZ	871
LDZ Optional Tariff	CAZ	881
Customer Capacity		
Customer LDZ Capacity	CAZ	CCA
Customer Capacity fixed Charge	CAZ	CFI
Unique Sites Customer Capacity	CAZ	872
Commodity		
LDZ Commodity	COM	ZCO
CSEP Commodity	COM	893
Unique Sites Commodity	COM	878
LDZ System Entry Commodity Charge	COM	LEC
Exit Capacity		
LDZ Exit Capacity	CAZ	ECN
CSEP Exit Capacity	CAZ	C04
Unique Sites Exit Capacity	CAZ	901
Other Charges		
LDZ Shared Supply Admin Charge	CAZ	883
CSEP Admin Charge	CAZ	894
Supplier of Last Resort (NEW)		
LRSP Domestic Charge	CAZ	LRD

Examples

This section provides illustrative examples of how transportation charges are used to calculate a bill for different load bands. However, as these calculations are subject to rounding they should only be regarded as purely illustrative. The commodity charges in these examples are also based on a supply point AQ, but the actual charges would vary depending on the actual consumption of the supply point for that period.

Charges produced by UK Link are definitive for charging purposes and take precedence to any examples listed within this section.

Example 1

A Shipper has a daily metered customer with an annual consumption (AQ) of 20,000,000 kWh and a registered supply point capacity (SOQ), booked directly by the Shipper of 100,000 kWh per day.

PROCESS		CALCULATIONS		
LDZ Capacity		LDZ Capacity		
Invoice:	LDZ Capacity (ZCA)	Volume:	365 days x 100,000 (SOQ)	36,500,000
See:	Table 2	Unit Rate:	$1.1369 \times 100,000 \text{ (SOQ)}^{-0.2155}$	0.0951
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£34,711.50
+				
LDZ Commodity		LDZ Commodity		
Invoice:	LDZ Commodity (ZCO)	Volume:	20,000,000 (AQ)	20,000,000
See:	Table 2	Unit Rate:	$0.2444 \times 100,000 \text{ (SOQ)}^{-0.2376}$	0.0159
Basis:	pence / kWh	Annual Charge:	Volume x Unit Rate	£3,180.00
+				
LDZ Customer (Capacity)		LDZ Customer (Capacity)		
Invoice:	LDZ Capacity (CCA)	Volume:	365 days x 100,000 (SOQ)	36,500,000
See:	Table 4	Unit Rate:	$0.0908 \times 100,000 \text{ (SOQ)}^{-0.2100}$	0.0081
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£2,956.50
+				
LDZ Exit Capacity		LDZ Exit Capacity		
Invoice:	Exit Capacity (ECN)	Volume:	365 days x 100,000 (SOQ)	36,500,000
See:	Table 6	Unit Rate:	0.0162 pence / peak day kWh / day	0.0162
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£5,913.00
=				
Total Annual Charge		£46,761.00		

Example 2

A Shipper has a domestic customer and the load has an AQ of 11,461 kWh per annum. In this example the load factor for this site is 31.1%. The peak daily load (SOQ) is therefore $11,461 \div (365 \times 0.311) = 101$ kWh.

PROCESS		CALCULATIONS		
LDZ Capacity		LDZ Capacity		
Invoice:	LDZ Capacity (ZCA)	Volume:	$(11461 \text{ (AQ)} / 365 \text{ days} / 31.1\%) \times 365$	36,865
See:	Table 2	Unit Rate:	0.2226 pence / peak day kWh / day	0.2226
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£82.06
+				
LDZ Commodity		LDZ Commodity		
Invoice:	LDZ Commodity (ZCO)	Volume:	11461 (AQ)	11,461
See:	Table 2	Unit Rate:	0.0385 pence per kWh	0.0385
Basis:	pence / kWh	Annual Charge:	Volume x Unit Rate	£4.41
+				
LDZ Customer (Capacity)		LDZ Customer (Capacity)		
Invoice:	LDZ Capacity (CCA)	Volume:	$(11461 \text{ (AQ)} / 365 \text{ days} / 31.1\%) \times 365$	36,865
See:	Table 4	Unit Rate:	0.128 pence / peak day kWh / day	0.1280
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£47.19
+				
LDZ Exit Capacity		LDZ Exit Capacity		
Invoice:	Exit Capacity (ECN)	Volume:	$(11461 \text{ (AQ)} / 365 \text{ days} / 31.1\%) \times 365$	36,865
See:	Table 6	Unit Rate:	0.0162	0.0162
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£5.97
+				
Supplier of Last Resort (SoLR)		Supplier of Last Resort (SoLR)		
Invoice:	SoLR (LRD)	Volume:	$(11461 \text{ (AQ)} / 365 \text{ days} / 31.1\%) \times 365$	36,865
See:	Table 7	Unit Rate:	0.0004	0.0004
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£0.15
=				
Total Annual Charge		£139.78		

Example 3

Suppose that instead of supplying just one domestic customer (as in Example 2) the Shipper supplies a connected system currently comprising 100 domestic customers and the completed connected system will include 150 domestic premises. Suppose that each of these premises has the same AQ of 15,000 kWh per annum.

Annual Quantity (AQ) = Number of premises x AQ per premise	Prevailing AQ (pre AQ)	100 houses x 15,000 (AQ) = 1,500,000 kWh
	Maximum AQ (max AQ)	150 houses x 15,000 (AQ) = 2,250,000 kWh
Supply Point Offtake Quantity (SOQ) = AQ ÷ (365 x Load Factor)	Prevailing SOQ (pre SOQ)	1,500,000 ÷ (365 x 0.313) = 13,130 kWh
	Maximum SOQ (max SOQ)	2,250,000 ÷ (365 x 0.313) = 19,695 kWh

Note: The prevailing annual and peak day loads of the connected system in effect would change over the year; however, for simplicity, these have been assumed as constant in this example.

PROCESS		CALCULATIONS		
LDZ Capacity		LDZ Capacity		
Invoice:	LDZ Capacity (891)	Volume:	13046 (pre SOQ) x 365 days	4,761,790
See:	Table 2	Unit Rate:	1.1369 x 19569 (max SOQ) x -0.2155	0.1352
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£6,437.94
+				
LDZ Commodity		LDZ Commodity		
Invoice:	LDZ Commodity (893)	Volume:	1500000 (AQ)	1,500,000
See:	Table 2	Unit Rate:	0.2444 x 19569 (max SOQ) x -0.2376	0.0234
Basis:	pence / kWh	Annual Charge:	Volume x Unit Rate	£351.00
+				
LDZ Exit Capacity		LDZ Exit Capacity		
Invoice:	Exit Capacity (C04)	Volume:	13046 (pre SOQ) x 365 days	4,761,790
See:	Table 6	Unit Rate:	0.0162	0.0162
Basis:	pence / peak day kWh / day	Annual Charge:	Volume x Unit Rate	£771.41
=				
Total Annual Charge		£7,560.35		

Contact Details

If you have any questions in relation to this document, please contact a member of the Revenue & Pricing team.

Sanjeet Kang

Regulatory Finance Manager

Phone: 0781 5465 207

Email: sanjeet.kang@cadentgas.com

Appendix A: Estimation of Peak Daily Load for Non-Daily Metered Supply Points

For non-daily metered (NDM) supply points, the peak daily load is estimated using a set of End User Categories (EUCs). Each NDM supply point is allocated to an EUC. In each LDZ, each EUC has an associated load factor.

A full list of the latest End User Categories, WAR bands and Load Factors for the East of England network are available electronically via the Correla (formerly Xoserve) secure internet site: [https://www.Correla \(formerly Xoserve\).com/systems/uk-link](https://www.Correla (formerly Xoserve).com/systems/uk-link).

These EUCs depend upon the annual quantity (AQ) of the supply point and, in the case of monthly read sites, the ratio of winter to annual consumption where available.

Monthly Read Sites

It is mandatory for supply points with an annual consumption greater than 293 MWh to be monthly read; however, at the Shipper's request, sites below this consumption may also be classified as monthly read.

For monthly read sites where the relevant meter reading history is available, the winter: annual ratio is the consumption from December to March divided by the annual quantity. If the required meter reading information is not available, the supply point is allocated to an EUC simply on the basis of its annual quantity. The peak load for an NDM supply point may then be calculated as:

$$\frac{AQ \times 100}{365 \times \text{Load Factor}}$$

Example

For a supply point in Eastern (EA) LDZ with an annual consumption of 1,000 MWh per annum: Assume consumption December to March inclusive is 440 MWh.

Winter: annual ratio = $440 \div 1000 = 0.44$

For a site with an annual consumption of 1,000 MWh (EUC Code EA:E2203B), a ratio of 0.44 falls within winter: annual ratio band W02 and the site is thus within End User Category EA:E2203W02.

For a site in this category, in this example the load factor is 45.7% and the peak daily load is therefore:

$$\frac{1000 \times 100}{365 \times 45.7\%} = 6.00 \text{ Mwh}$$

If the required meter reading information is not available to calculate the winter: annual ratio, the supply point is allocated to an EUC simply on the basis of its annual quantity, in this case EA:E2203B. For this example, for a site in this category, the load factor is 34.1% and the peak daily load is therefore:

$$\frac{1000 \times 100}{365 \times 34.1\%} = 8.03 \text{ Mwh}$$

Six Monthly Read Sites

In the case of six monthly read sites, the supply point is allocated to a EUC simply on the basis of its annual quantity.

Daily Metered Supply Points

The SOQ of daily metered sites is known and hence no load factor is required.

Supply points with an AQ above 73.2 MWh pa may, at the Shipper's request, be classified as daily metered.

Consultation on End User Categories

Section H of the Network Code requires the Transporter to publish, by the end of June each year, its demand estimation proposals for the forthcoming supply year. These proposals comprise end user category definitions, NDM profiling parameters (ALPs and DAFs), and capacity estimation parameters (EUC load factors). Analysis is presented to users and the Demand Estimation Sub-Committee (a sub-committee of the Network Code Committee) is consulted before publication of the proposals.

Appendix B: Application of Transportation Charging Methodology

Standard Special Condition A4 of the Transporter's Gas Transporter (GT) Licence requires the Transporter to establish a charging methodology and to set out the application of the methodology, showing the methods and principles on which the transportation charges are based. The present charging methodology was introduced in 1994 and has been modified from time to time in accordance with the GT Licence.

Price Control Formulae

The Maximum Allowed Revenue under the transportation controls is determined by a number of factors including:

- The Base Revenue determined through the Final Determination for RIIO2-GD2 by Ofgem.
- The indexation factor - under the distribution formula, allowed revenue is adjusted each year by a factor equal to the forecast rate of inflation, with a subsequent true-up for actual inflation, measured by reference to the Consumer Price Index including Owner Occupiers' Housing Costs.
- Legacy Adjustments from RIIO-1 which include, but not limited to pass through and MODt
- Any under or over-recovery, known as K correction factor, now in RIIO-2 is lagged by one year, whereas in RIIO-1 it was lagged by 2 years. The Allowed Revenue in 24/25 has both K correction factors from 22/23 and 23/24 applied to it.

The "K" correction factor is necessary because the level of charges set under the control depends on forecasts of some of the above elements. Outturn will inevitably differ from forecast, thus giving rise to variances between the amount of revenue generated and that allowed under the control. The K factor enables correction for these variances by adjusting either upwards or downwards the maximum level of revenue allowed in subsequent formula years (taking interest into account).

Objectives of the Charging Methodology

The transportation charging methodology has to comply with objectives set out in the Licence under Standard Special Condition A5. These are that:

- Compliance with the charging methodology results in charges which reflect the cost incurred by the transporter in its transportation business
- Facilitates competition between gas shippers and between gas suppliers
- Takes account of developments in the transportation business

In addition to these Licence objectives, Cadent has its own objectives for the charging regime. These are that the transportation charging methodology should:

- Promote efficient use of the transportation system
- Generate stable charges
- Be easy to understand and implement

Before the Transporter makes any changes to the methodology, it would raise a UNC modification proposal in line with the UNC procedures and consult with the industry in accordance with Standard Special Condition A5 of the Licence. Ofgem has the right to veto any proposed changes to the methodology.

Structure of LDZ System and Customer Charges

The LDZ charges are split between system related activities and customer related activities. While total LDZ revenue is determined by the relevant price control, the share of this revenue to be recovered from the LDZ system charges and the LDZ customer charges respectively is based on the relative cost of each area of activity. The current split is set out in the below:

Table B.1 Split of LDZ System and Customer charges (%)

LDZ System	LDZ Customer	Total
70.5%	29.5%	100%

The Gas Distribution networks are in the process of reviewing the above percentage splits to ensure they are still broadly reflective of the costs now and moving into RIIO-GD2.

Having established by the above methods the target revenue to be derived from each main category of charge, the next step is to structure the charges within each of these charge categories across the load bands, such that they reasonably reflect the costs imposed on the system by different size loads. The methodology used to do this is described in the appropriate sections below.

LDZ System Charging Methodology

The Standard LDZ System charges effective from 1st April 2013 are based on the methodology fully described in consultation paper DNPC08 - Review of Standard LDZ System Charges. This methodology is described below and was based on an analysis of Network costs and usage and a 95:5 capacity/commodity split.

The distribution network contains a series of pipe networks split into four main pressure tiers:

Table B.2 LDZ Pressure Tiers

Pressure Tier	Operating Pressure
Local Transmission System (LTS)	7 - 38 bar
Intermediate Pressure System (IPS)	2 - 7 bar
Medium Pressure System (MPS)	75 mbar - 2 bar
Low Pressure System (LPS)	Below 75 mbar

Determination of Costs

The costs related to each pressure tier were derived from the split of distribution network costs undertaken as part of DNPC05, with further analysis to allocate the LDZ System costs across the pressure tiers and sub-tiers. These costs are split 95:5 into capacity and commodity elements in line with the methodology established by DNPC03.